

## CARBON DIOXIDE CO<sub>2</sub>

Industrial fire suppression systems



Kidde engineers developed carbon dioxide fire extinguishing over 60 years ago and Kidde have been responsible for every major improvement that has been made in this branch of fire protection. Kidde Products benefits from the accumulated experience of thousands of installations in power plants, industrial plants, oil refineries, electronic processes, on ships and in a wide variety of hazardous areas.

#### CO<sub>2</sub> is versatile

The CO<sub>2</sub> is stored as liquid, under pressure. When a system is activated, the liquid CO<sub>2</sub> flows through discharge pipework to specially designed nozzles. The agent's low boiling point means that the liquid vaporises rapidly during the discharge, providing a penetrative three-dimensional action. The rapid expansion of the gaseous agent allows fires to be targeted even in the most inaccessible areas of the risk.

Fire is extinguished by reducing the oxygen level in the risk area to the point where combustion cannot be sustained. Cooling is a secondary action of the agent; this feature is used in local applications where the liquid phase of the discharge is applied directly to the fire and risk materials.

#### CO<sub>2</sub> is fast and efficient

The Kidde High Pressure CO<sub>2</sub> system uses a large bore discharge valve, enabling high mass flow rates to be achieved. The fast action of the

control system and valve enables the system to react within the first few seconds of a fire that can make the difference between a nuisance and a disaster.

#### CO<sub>2</sub> is clean

CO<sub>2</sub> is a colourless, odourless, dry, inert gas and is one of the most familiar of all chemicals. After extinguishing a fire it vapourises fully leaving no residue. There is no mess, nothing to clear up, no water damage. It is non-corrosive and will not contaminate foodstuffs. It is non-conductive and so can be used on energised electrical equipment. It is safely used to protect delicate electrical equipment, antiques or archive materials.

#### CO<sub>2</sub> is low cost

Carbon dioxide is a standard commercial product with many other uses and it is readily available throughout the world. Because of its universal use it can be obtained cheaply and this is an important consideration when frequent recharging of storage containers is





Control head with pilot cylinder



Solenoid for control head



Klem valve with metron actuator



Klem valve with solenoid actuation



Discharge nozzles



Manual pull box



Pressure Switch



Pressure Trip



Cylinder contents monitoring option

necessary as in local application systems, where fires may be more frequent.

### Benefits

- High flow 'Klem' valve
- Manual or Automatic operation
- Pilot cylinder or Direct Acting Solenoid options
- Continuous weight monitoring option
- Design compliance with BS5306-4
- Fully compatible with Kidde Extinguishing Control Panels

### Typical applications

- Flammable liquid storage areas
- Printing presses, flow solder machines
- Quench tanks/exhaust fume ducts
- Paint spray booths
- Fryers/ovens
- EDP/computer rooms and floor voids\*
- Commercial kitchens
- Industrial Fryers/ovens
- Transformers
- Generators

\* CO<sub>2</sub> is not the agent of choice for manned areas, please contact KFP applications for more information.

### System design

Details of both total flooding and local application systems are contained in the KFP CO<sub>2</sub> Design Manual.

### Flexible design

The wide range of components manufactured by Kidde enables systems to be engineered to suit individual customer requirements. Systems can be either automatically or manually operated and arranged to protect single or multi-zone hazards and with any number of reserve discharges. Automatic control can be achieved mechanically, pneumatically or electronically or by any combination of these to suit site conditions.

Facilities are available for providing a pre-alarm and delayed discharge as well as various methods of preventing automatic release while protected rooms are occupied by personnel.

Audible and visual indications of system control can be provided together with facilities to automatically shut fuel valves, fire doors, dampers and shutters by either mechanical or electrical devices.

CO<sub>2</sub> is stored in solid drawn steel cylinders manufactured to British Standards. The storage pressure varies with ambient temperature but is 58.6 bar at 21°C.

Any number of cylinders can be manifolded together and simultaneously released to provide the total design requirement of CO<sub>2</sub>.

### Approvals

Major approvals for the Kidde Products CO<sub>2</sub> system include:

- Factory Mutual (FM)
- Lloyds
- American Bureau of Shipping
- Det Norske Veritas
- Maritime and Coastguard Agency (UK DETR)
- Germanischer Lloyd



Extinguishing Control Panel

## 3 CARBON DIOXIDE CO<sub>2</sub>

### Total Flooding Systems


Total flooding systems extinguish fires by rapidly discharging CO<sub>2</sub> into an enclosed volume to create an atmosphere that is incapable of supporting combustion.

The agent mixes homogeneously within the risk area to generate a CO<sub>2</sub> concentration by volume of at least 34%. This concentration of CO<sub>2</sub> presents a serious hazard to personnel and under no circumstances should CO<sub>2</sub> be released into areas that may be manned at the time of discharge.

Total flood CO<sub>2</sub> systems are ideal for unmanned applications such as transformer rooms, remote switch rooms, generators and archives. All systems should be installed with safety systems in place to prevent the inadvertent release of agent into occupied spaces. Kidde offer time delays, isolating valves including distribution valves and control head lockout pins to facilitate the safe use of CO<sub>2</sub>.

### Legend

- 1 CO<sub>2</sub> cylinder assembly
- 2 Cylinder valve and actuator
- 3 Solenoid
- 4 Nitrogen pilot cylinder and control head
- 5 Manual push button
- 6 Pressure relief device
- 7 Isolating ball valve
- 8 Discharge pressure switch
- 9 Pilot bleed
- 10 Pressure trip
- 11 Extinguishing control panel
- 12 Status indicator unit
- 13 Status indicator with release control
- 14 1st stage alarm sounder
- 15 2nd stage alarm sounder
- 16 Discharge nozzle
- 17 Fire door
- 18 Smoke detector

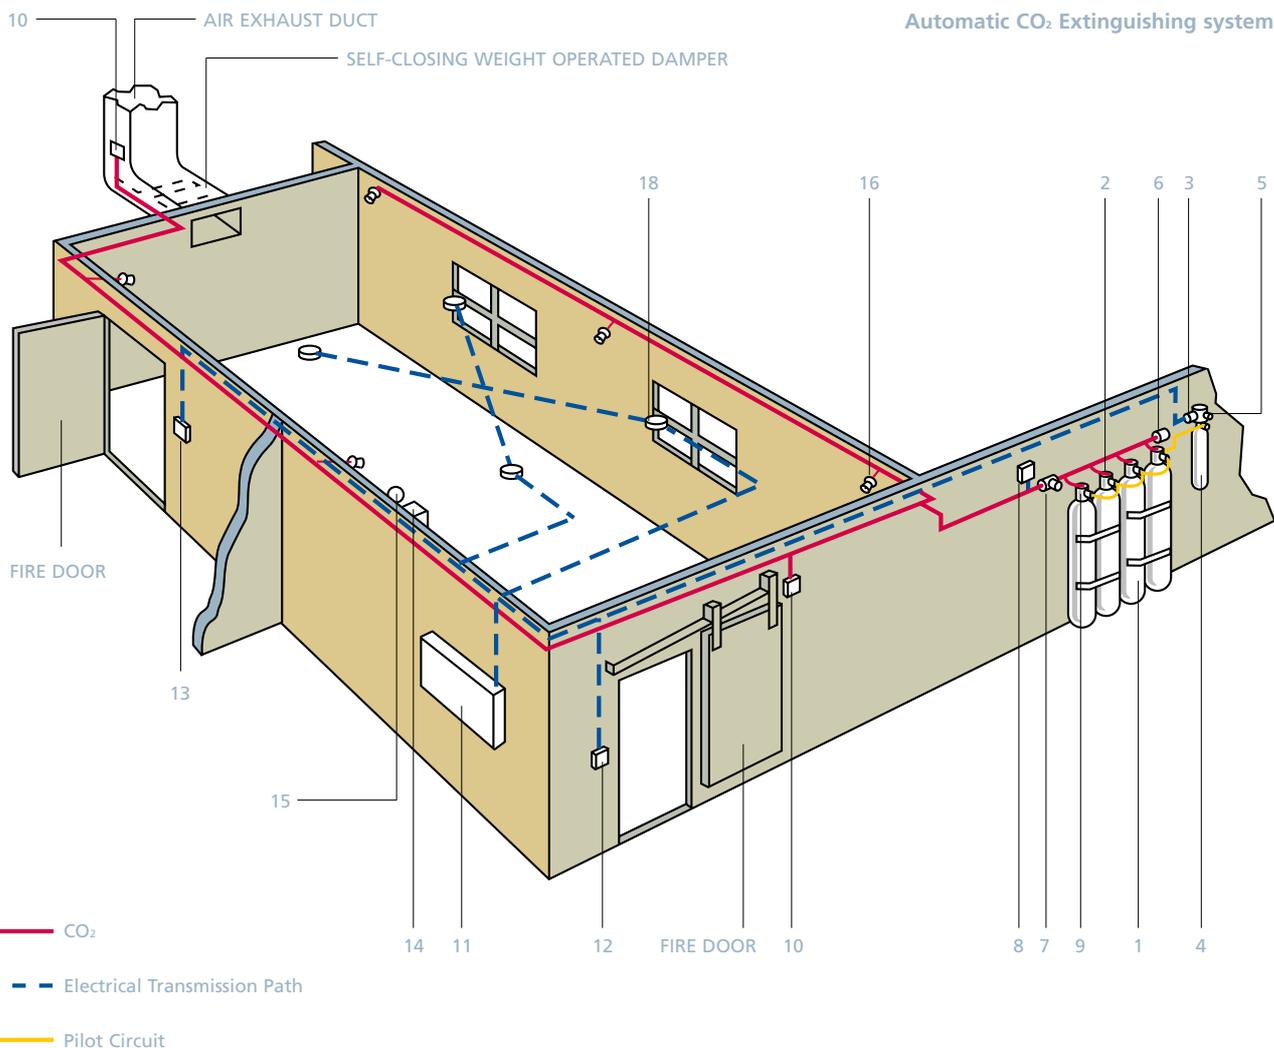

## 4 CARBON DIOXIDE CO<sub>2</sub>

### Local Application


This method of system design is used to protect hazards that are open or have only partial enclosure, situated within a larger area that would be unsafe or uneconomic to protect using a total flood system. Discharge nozzles are placed so as to provide direct agent flow at the points and areas prone to fire. The direct contact of the rapidly expanding CO<sub>2</sub> provides efficient cooling and the gas dramatically reduces the oxygen concentration in the hazard zone.

Local application systems are designed to provide extremely fast discharges to 'knock-down' the fire in a matter of seconds. These systems are very effective and are often installed with connected reserve banks so that the system can be reinstated during the same shift as a fire event, while the empty cylinders are recharged.

### Legend

- 1 CO<sub>2</sub> cylinder assembly
- 2 Cylinder valve and actuator
- 3 Pneumatic actuator
- 4 Nitrogen pilot cylinder and control head
- 5 Discharge pressure switch
- 6 Pressure relief device
- 7 Isolating ball valve
- 8 Pressure trip
- 9 Break glass pull box
- 10 Discharge nozzle, multi-jet horn
- 11 Pneumatic, rate of rise detector
- 12 Flanged, multi-jet nozzle

### Mechanical Automatic, Local Application CO<sub>2</sub> Extinguishing system

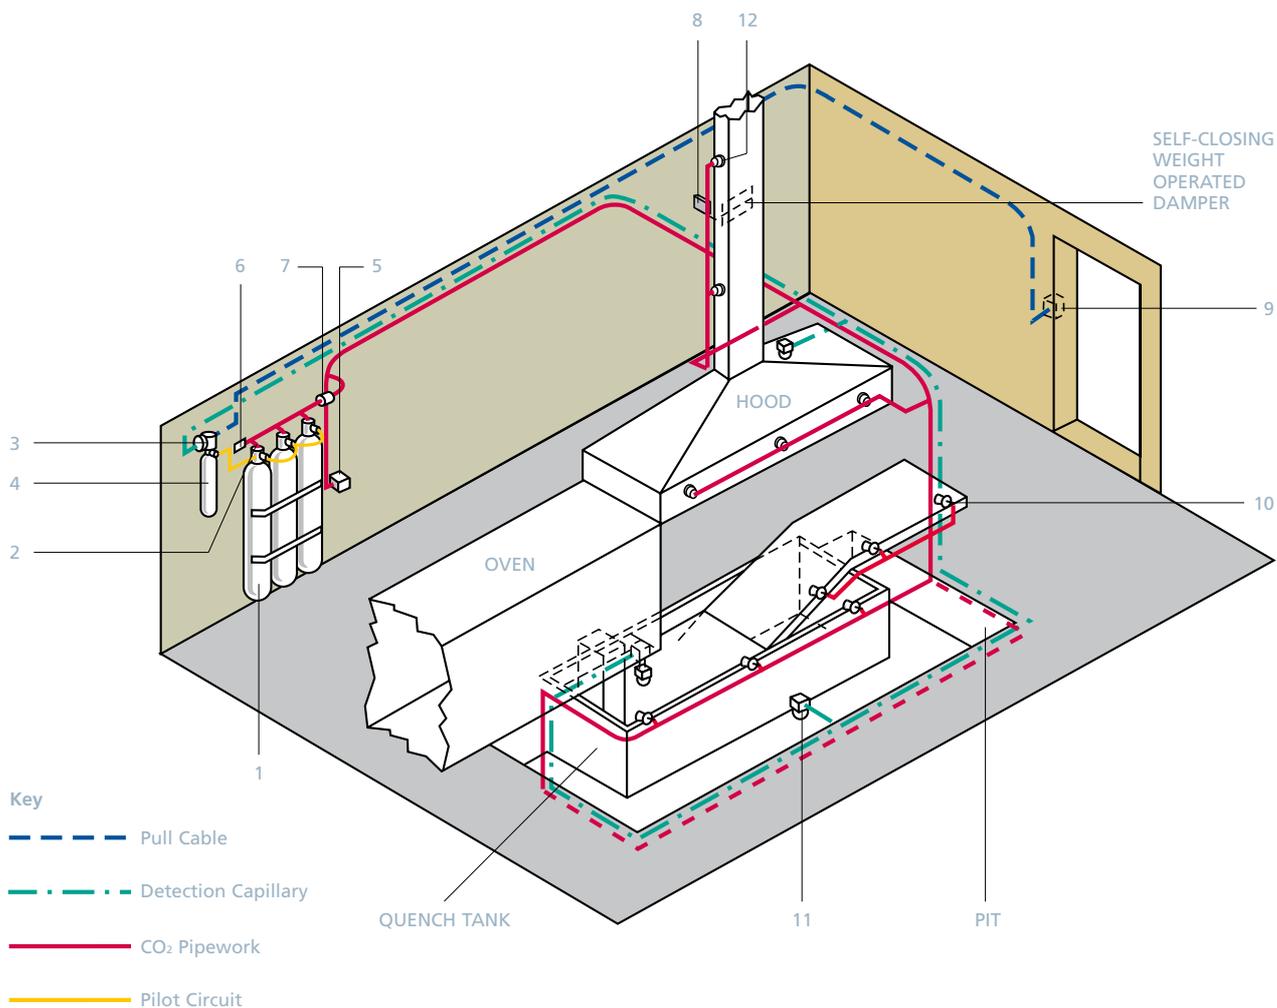



### System Information

#### Total Flooding Systems

#### Surface Fires

Fires involving flammable liquids, gases or solid materials not subject to smouldering are known as surface type fires.

The design concentration of CO<sub>2</sub> provided must be maintained for 10 minutes.

Basic quantities of carbon dioxide for various space volumes may be calculated from Table 1.

The basic quantity of CO<sub>2</sub> is factored according to the risk material. Some typical values are shown in Table 2.

#### Deep Seated Fires

A fire involving a solid material that is subject to smouldering is called a deep seated fire.

Rooms containing these materials should have no openings that cannot be automatically closed, other than small openings or pressure vents near the top of the enclosure.

Additional quantities of CO<sub>2</sub> are needed and held within the space for not less than 20 minutes.

Recommended design concentrations for various hazards are shown in Table 3.

#### Integrity and venting requirement

Total flood suppression systems rely on the enclosure retaining the required gas concentration for a period of time known as the hold time. The ability of the hazard enclosure to retain the gas for the required hold is usually determined by door fan integrity

testing. If the test shows that the leakage would reduce the hold time below that specified for the fire type, additional CO<sub>2</sub> must be provided.

The release of CO<sub>2</sub> into a tightly sealed enclosure could result in damage caused by pressure variations during discharge. Normally the natural leakage of an enclosure is adequate to prevent damage but in some cases pressure relief venting may be required.

### System Information

#### Local Application Systems

#### Volume Method

The volume method of system design is used where the fire hazard consists of three dimensional irregular objects that cannot easily be reduced to equivalent surface area.

The total discharge rate of the system is based on the volume of an assumed enclosure surrounding the hazard. The basic design rate is 16 kg min m<sup>-3</sup> but this can be reduced according to the degree of existing enclosure on site.

#### Area Method

The quantity of carbon dioxide required is based upon the total discharge rate from a carefully sited nozzle arrangement, a sufficient number of nozzles being used to adequately cover the entire area on the basis of the unit area protected by each nozzle.

For this method of design, where a horizontal or vertical flat surface is protected, nozzles are to be positioned in accordance with the guidance of the Kidde CO<sub>2</sub> design manual. The position and distance from the hazard has a critical effect

on the quantity of CO<sub>2</sub> required. This protection methodology is well suited to painting, dipping and drying type applications.

**Table 1**  
– to determine basic CO<sub>2</sub> quantity

Volume - m <sup>3</sup>		Factor - kg.m <sup>3</sup>
>4	>14	1.15
>4	>14	1.07
>14	>45	1.01
>45	>126	0.90
>126	>1400	0.80
>1400		0.74

**Table 2**  
– to determine higher concentrations for specific hazards

Capitalise factor	
Acetylene	2.5
Benzol	1.1
Butadiene	1.3
Ethyl Ether	1.5
Ethylene	1.6
Hexane	1.1
Hydrogen	3.2
Kerosene	1.0
Petrol	1.0

**Note: MCF of 1.0 is equal to a concentration of 34%**


**Table 3**  
– concentrations for deep seated hazards (BS5306: 4)

Hazard	Flooding Factor
Dry electrical wiring and insulation	1.35kg m <sup>-3</sup>
Computer equipment	1.50kg m <sup>-3</sup>
Data processing and tape storage	2.25kg m <sup>-3</sup>
Record stores/archives	2.00kg m <sup>-3</sup>
Dust collectors	2.70kg m <sup>-3</sup>

## 6 CARBON DIOXIDE CO<sub>2</sub>

### Ordering information for typical pilot cylinder actuated CO<sub>2</sub> system (up to 10 off 45kg cylinders)

Description	Part No.	1 Cyl	2 Cyl	3 Cyl	4 Cyl	5 Cyl	6 Cyl	7 Cyl	8 Cyl	9 Cyl	10 Cyl
45 kg CO <sub>2</sub> Cylinder (full)	K24069/L/R or E7194-007	1	2	3	4	5	6	7	8	9	10
2 Cylinder 1" Manifold	K21207		1								
3 Cylinder 1" Manifold	K21209			1							
4 Cylinder 1" Manifold	K21211				1						
5 Cylinder 1" Manifold	K21213					1					
Combination of 1" or 1 1/4" manifolds as required							•	•	•	•	•
Single Row M/Fold Bt. 1"	K24267D		2	2	2	3	•	•	•	•	•
Flexible Loop	K97112	1	2	3	4	5	6	7	8	9	10
Pressure/Lever Actuator	K62341	1	2	3	4	5	6	7	8	9	10
2 Cylinder Backrack	K17238		2		4	2		4	2		4
3 Cylinder Backrack	K17235			2		2	4	2	4	6	4
2 Cylinder Frontstrap	K13744		2		2	2		4	2		4
3 Cylinder Frontstrap	K13745			2		2	2	2	4	6	4
Single Row Rack Bolt inc nuts	K62752		2	4	4	6	8	8	10	12	12
Hose/Pipe Adapter	K62755	1									
System Control Head	K62303	1	1	1	1	1	1	1	1	1	1
Solenoid (std) 24V dc	K62422B	1	1	1	1	1	1	1	1	1	1
Pilot Cylinder	K62462	1	1	1	1	1	1	1	1	1	1
Wall Mount	K62487	1	1	1	1	1	1	1	1	1	1
Pilot Vent (Bleed)	K24051	1	1	1	1	1	1	1	1	1	1
Pilot Loop (Long)	K93434	1	1	1	1	1	1	1	1	1	1
Pilot Loop (Short)	K93433		1	2	3	4	5	6	7	8	9
Single Cylinder Strap	K62943	2									

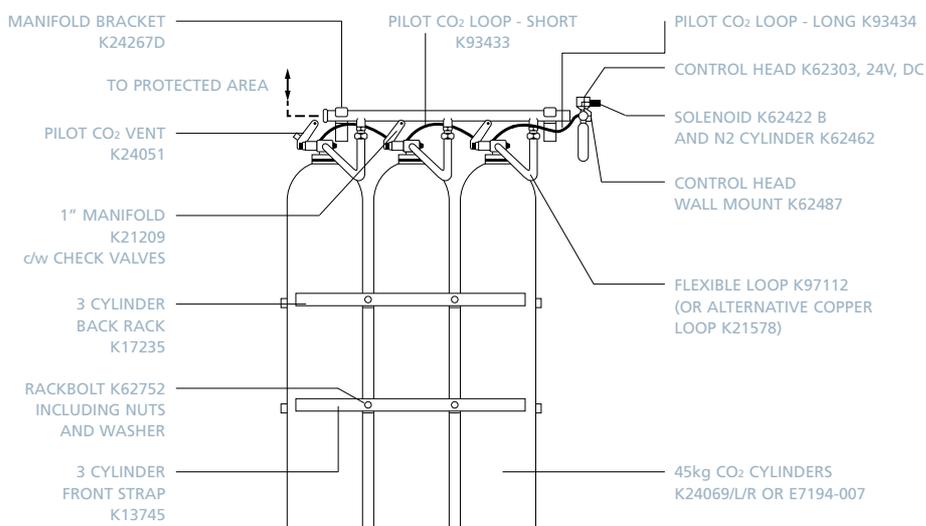

#### Other equipment to suit specific systems

- Discharge nozzles
- Warning labels (metal or self-adhesive)
- Pressure switch
- Break glass pull box
- Pneumatic time delay unit
- Pressure relief devices
- Pressure Operated Direction valve
- Isolating valve
- Control and detection equipment
- Alarm devices
- Mechanical detection/actuation (As required)

## 7 ELECTRICALLY ACTUATED CO<sub>2</sub> SYSTEM



### Direct-acting CO<sub>2</sub> Solenoid

Designed for use with standard Kidde 45kg CO<sub>2</sub> cylinders, the direct-acting solenoid allows CO<sub>2</sub> systems to be actuated electrically without the need for a separate pilot nitrogen supply.

The solenoid actuation system utilises a modified version of the existing cylinder valve, replacing the nitrogen pilot cylinder with a solenoid directly coupled to the CO<sub>2</sub> cylinder valve. The system also retains the facility for local manual release or via a mechanical pull cable.

### Operation

The pressure/manual actuator (K62341) is fitted to the cylinder (Klem) valve, with the solenoid assembly (D8522-001) attached to the poppet orifice connection by means of a swivel nut and O-ring seal. The solenoid assembly has a flexible hose connection to the pressure/manual actuator.

In the unactivated state, the pneumatic actuator is subject only to atmospheric pressure and the Klem valve remains closed. On receipt of an electrical signal from an extinguishant release control panel, the solenoid coil is activated, releasing high pressure CO<sub>2</sub> from the cylinder. The CO<sub>2</sub> passes through a short flexible hose to the pressure/manual actuator, which then operates the Klem valve, allowing CO<sub>2</sub> to exit via the discharge port. Further CO<sub>2</sub> cylinders may be discharged by interconnecting the pressure/manual actuators using flexible pilot hoses (K93433).

Also available, Metron actuator c/w manual lever (D8521-002), ideal for single cylinder electrical operation.




## 8 ELECTRICALLY ACTUATED CO<sub>2</sub> SYSTEM

### Specification

Voltage range	18V DC to 28V DC
Current at 28V DC	526 mA
Minimum firing pulse	60mS
Electrical connection	DIN plug type DIN 43650
Maximum working pressure	152.5 bar (g)
Current at 18V DC	338 mA
Nominal coil resistance	53.2 ohm
Maximum firing pulse	Unlimited
Operating temperature range	-20°C to +55°C
Environmental protection	BS EN 60529 1991 IP65

Item	Part No.	Description	Quantity
1	D7226-007	Klem valve & cylinder assembly	1
2	D8522-001	Klem valve solenoid assembly	1
3	K93433	Bundy tube, flexible loop	1
4	K62341	Actuator, pressure/manual	1
5	D7564-001	Bleed assembly	1

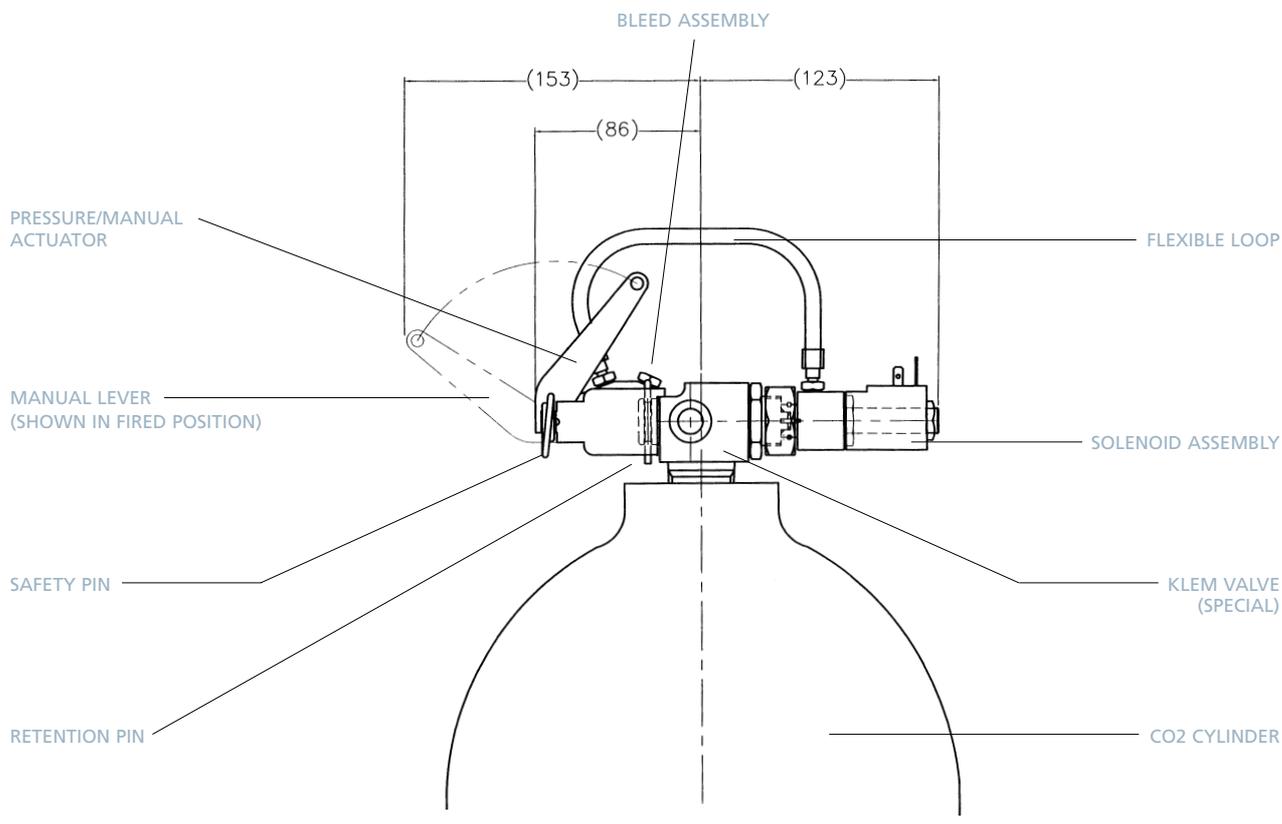

### Kidde Fire Protection

#### UK Sales Office – Head Office

Thame Park Road, Thame, Oxfordshire OX9 3RT, UK.

Tel: +44 (0)1844 265003. Fax: +44 (0)1844 256156. E-mail: [info@kfp.co.uk](mailto:info@kfp.co.uk) Web: [www.kfp.co.uk](http://www.kfp.co.uk)

#### UK Sales Office

Unit 12, Atley Way, North Nelson Industrial Estate, Cramlington, Northumberland NE23 1WA UK

Tel: +44 (0)1670 713455. Fax: +44 (0)1670 735553

#### International Offices

Dubai: Tel: +971 4 337 2498. Fax: +971 4 337 5088

Hong Kong: Tel: +852 2195 3688. Fax: +852 2743 7477

Singapore: Tel: +65 424 7979. Fax: +65 424 7978

Australia: Tel: +61 3 9765 3850. Fax: +61 3 9765 3800